

Sample Received: April 23, 2026

COA Issued: April 30, 2026

PRODUCT INFORMATION


|                   |                      |                         |               |                              |
|-------------------|----------------------|-------------------------|---------------|------------------------------|
| Vendor:           | Sample Name:         | Sample Type:            | Lot Number:   | MW (g/mol):                  |
| Peak Lab Peptides | CU, TB, BC, KPV 80mg | Blue lyophilized powder | KL-202604-001 | 403.2, 4964.2, 1419.5, 342.4 |

ANALYTICAL METHODS

Identity: Confirmed via MALDI-MS  
Purity: RP-HPLC (214 nm)  
Content: HPLC quantitation

TEST RESULTS

| Specification             | Result                        | Method            | Status     |
|---------------------------|-------------------------------|-------------------|------------|
| Identity: CU, TB, BC, KPV | GHK-Cu, TB-500, BPC-157, KPV  | MALDI-MS          | ✓ Conforms |
| Content                   | 50.54, 10.25, 10.62, 10.29 mg | HPLC Quantitation | ✓ Conforms |
| Overall Purity            | 99.9%                         | RP-HPLC (214 nm)  | ✓ Conforms |

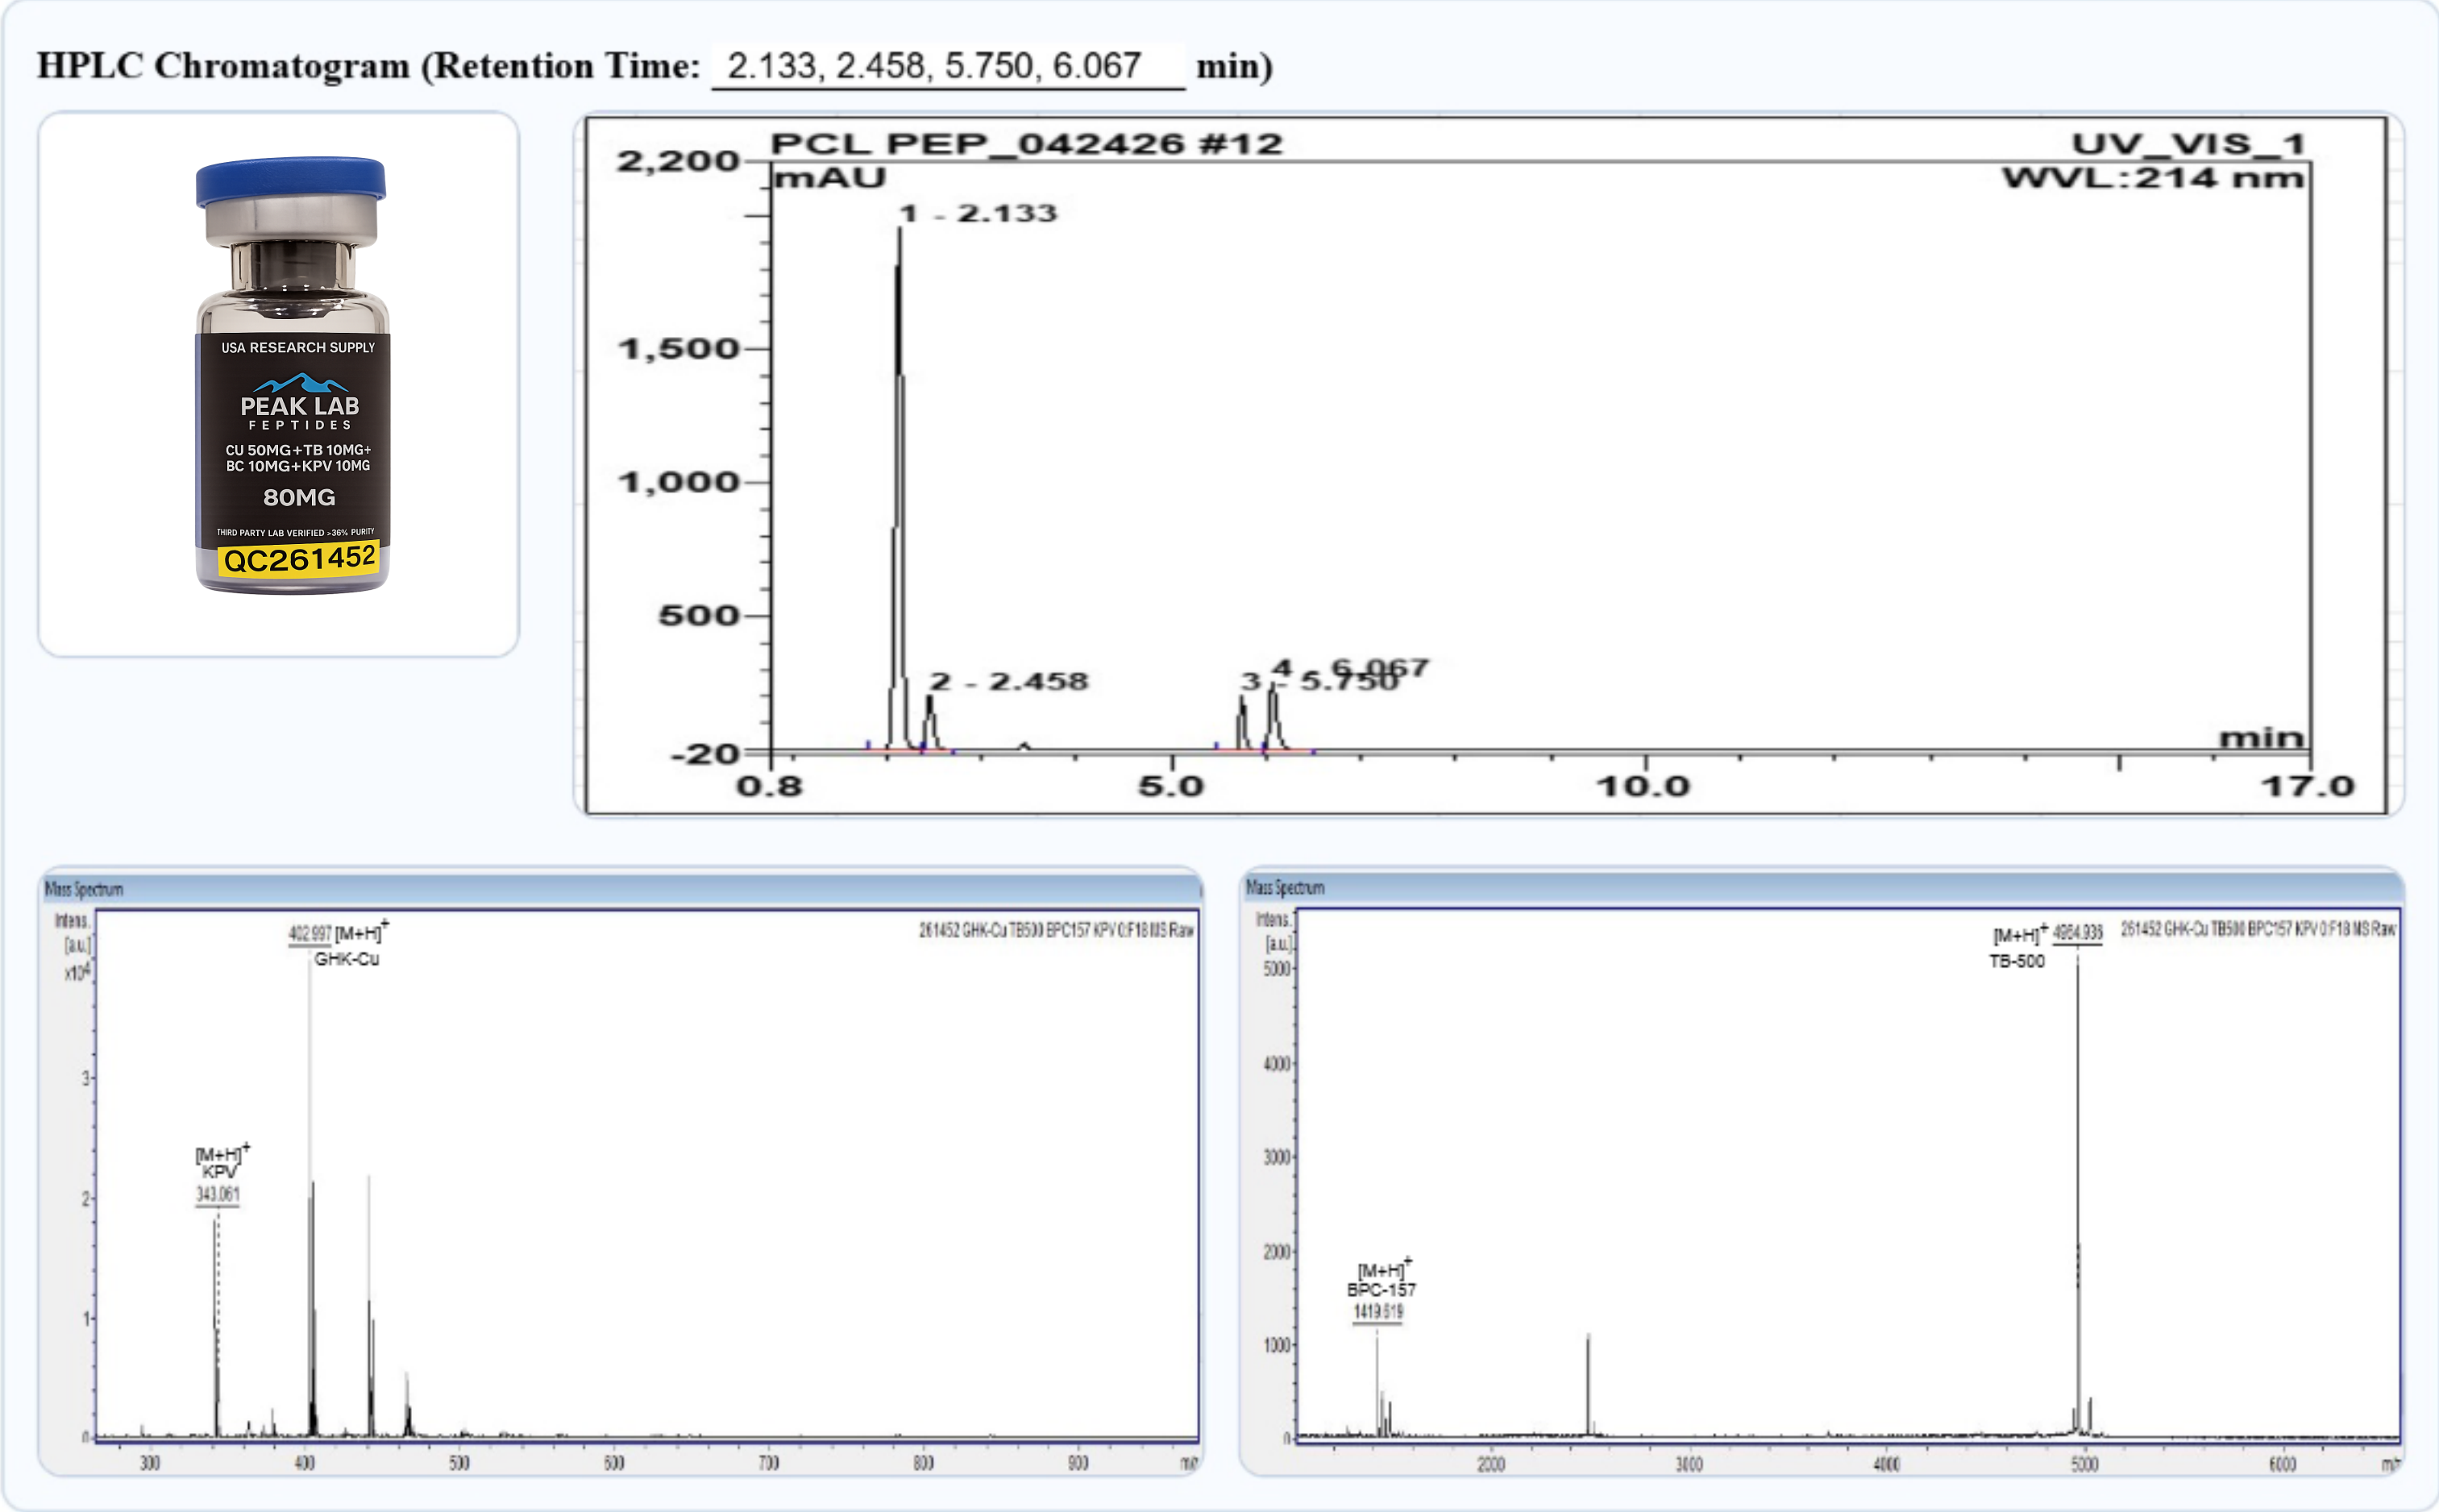

**Certification:** This COA confirms that the tested material meets or exceeds Bioviridian’s analytical quality specifications for peptide research use.  
Visit: <https://bioviridians.com/coa-search.html>



Shane Straight

Shane Straight, M.S.  
Principal Chemist, Bioviridian Inc.